


REMARKS

Applicants have submitted amended drawings in response to the Notice of Omitted Items in a Nonprovisional Application, dated May 17, 2004, and the subsequent Notice of Non-Compliant Amendment, dated August 20, 2004. The enclosed replacement drawings are labeled with "Replacement Sheet" in accordance with 37 CFR 1.84. Annotated copies of each drawing showing the changes are labeled "Annotated Marked-up Drawings" are also included. Applicants believe that the enclosed drawings meet the requirements of an amended document as set forth in 37 CFR 1.121.

Should the Examiner have any questions concerning the enclosure submitted herewith, the Examiner is invited to telephone the undersigned agent of record at the number provided.

Respectfully submitted,



Shane H. Hunter, Esq.
Registration No. 41,858
MINTZ, LEVIN, COHN, FERRIS
GLOVSKY and POPEO, P.C.
One Financial Center
Boston, MA 02111
Telephone 617/348-1661
Attorneys for Applicants

Date: February 18, 2005

In the drawings:

In FIG. 1, add two connections from MOSFET bridge 6 to multi-trip transformer circuit 4 as shown in red ink.

In FIG. 3, add reference designator 56b and accompanying lead line as shown in red ink.


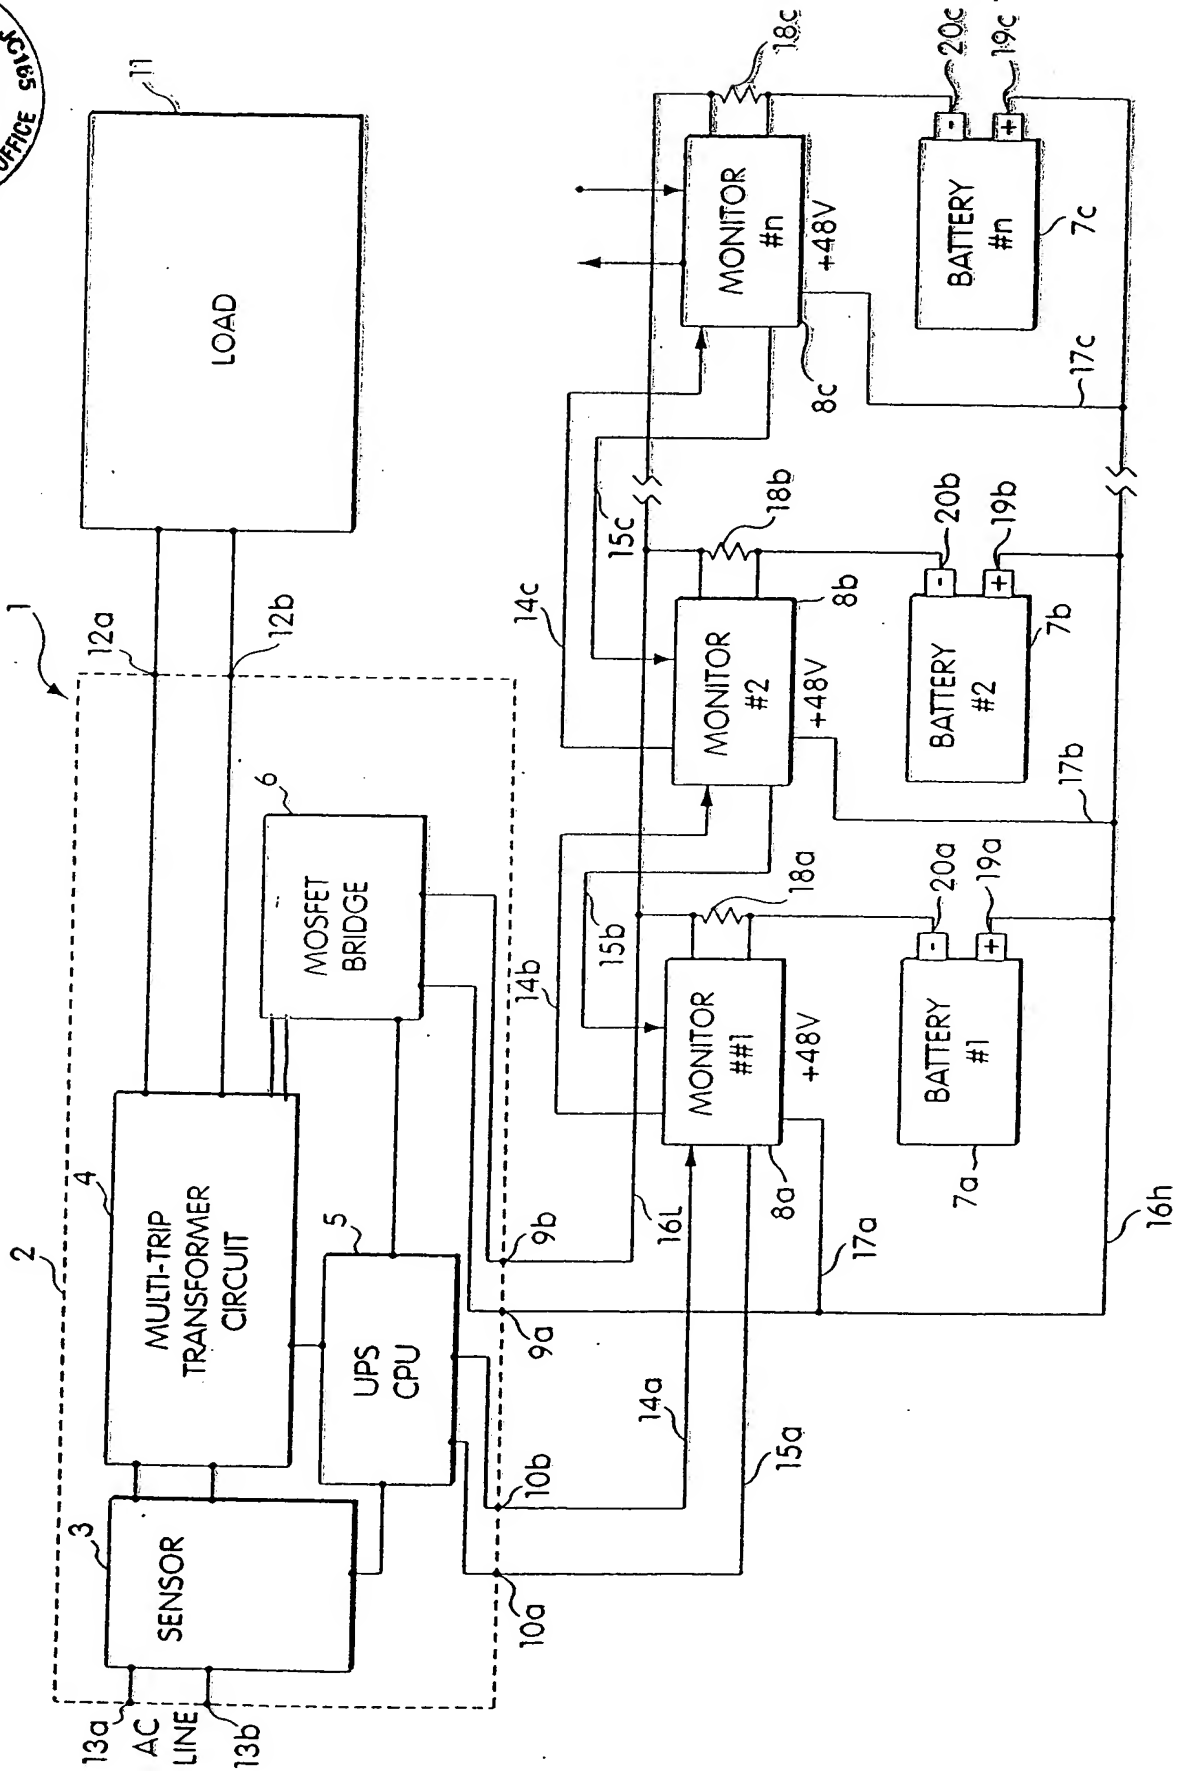


Fig. 1



3
Fi. 9.